

# GEORGETOWN DIVIDE PUBLIC UTILITY DISTRICT

## Operations Manager's Report for September 2020

Presented to the GDPUD Board of Directors by Darrell Creeks, Operations Manager

October 13, 2020, AGENDA ITEM #6.C.

### Water Production for the Month of

#### August

#### Sweetwater Treatment Plant

32.509 million gallons  
1,0838,633 gallons/day average

#### Walton Lake Water Treatment Plant

34.756 million gallons  
1,158,533 gallons/day average

### Water Quality Monitoring

Monitoring has been completed and reports have been submitted to the State Water Resources Control Board.

- ✓ The treatment plants are in compliance with all drinking water standards,
- ✓ Distribution system monitoring results showed all samples absent/negative of any bacteriological contamination and indicate adequate levels of disinfection through the system.

### Stumpy Meadows Volume (Acre-FT) September 13,624


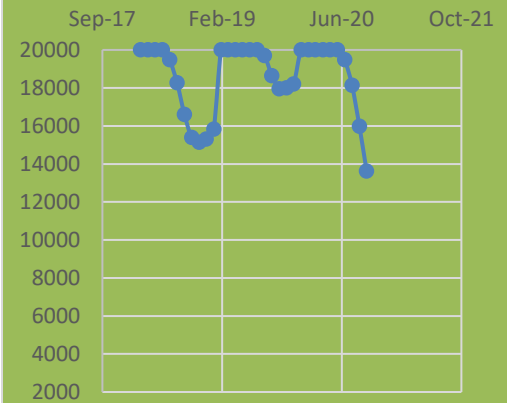


Chart Water Production (MG)

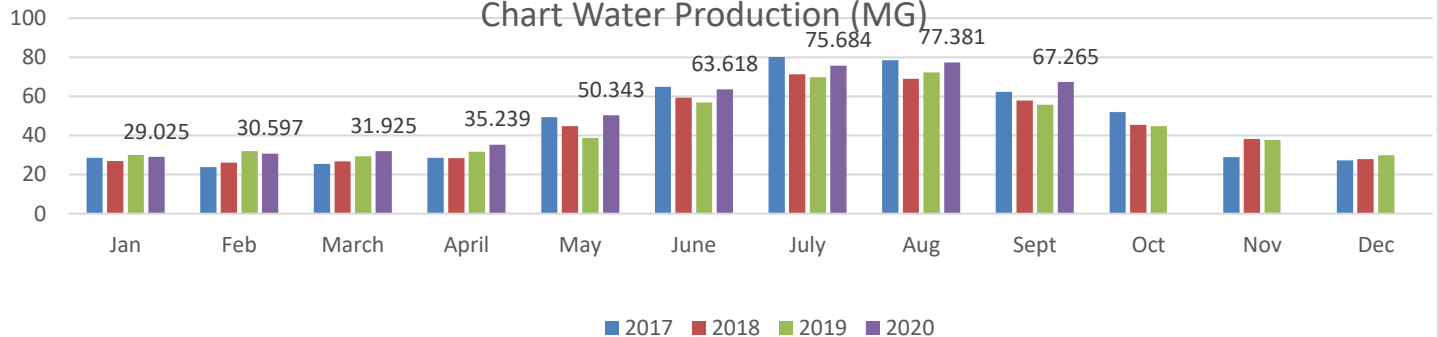

### Summary of Field Work Activities

#### Operations Manager

Filter 3 rebuild at Walton Treatment Plant is starting on October 7.

Office and Corp Yard Roof repairs will begin on October 13.

#### Distribution Crew

- ✓ Repaired leaks: 11 service leaks and 1 main leak
- ✓ Repair/replace meters: 0
- ✓ Installed new service: 2 treated
- ✓ After Hours Callouts: 25
- ✓ Exercised 4 valves

#### Maintenance Crew

- ✓ Ended Irrigation Season
- ✓ Clearing canals and sealing leaking areas
- ✓ Helping customers with their services
- ✓ Cleaned Grizzlies and waste gates

#### Georgetown Divide Public Utility District

6425 Main Street P.O. Box 4240, Georgetown, CA 95634 • (530) 333-4356 • [www.gd-pud.org](http://www.gd-pud.org)  
Jeff Nelson, PE, Interim General Manager • Darrell Creeks, Operations Manager